

A NEW APPROACH FOR DETERMINATION OF REAL AND REACTIVE POWER PRICING USING UPFC IN INDIAN ELECTRICITY MARKET

P. Vidhya^{#1}, R. Ashok Kumar^{*2} and K. Asokan^{*3}

Address for Correspondence

¹Assistant Professor, Department of Electrical Engineering, Annamalai University, Annamalai Nagar - 608 002 Tamil Nadu, India

²Professor, Department of Electrical Engineering, Annamalai University, Annamalai Nagar - 608 002, Tamil Nadu, India

³Assistant Professor, Department of Electrical Engineering, Annamalai University, Annamalai Nagar - 608 002, Tamil Nadu, India

Abstract- Reactive power service plays an important role as an ancillary service in competitive power markets. Appropriate management and provision of reactive power is very essential for power system security and reliable operation of the system. Generators are the main source of reactive power generation and the cost of reactive power should be considered for their noticeable impact on both real and reactive marginal prices. In this paper, a method based on locational marginal prices calculation for real and reactive power by considering variety of reactive power models for providing reactive power support. The introduction of the FACTS controllers in the system enhances more flexible operation and their role in marginal price determination and its cost function are taken into account. The proposed approach is applied on Indian 246-NREG bus system to illustrate the effectiveness of the framework and the test results are presented. The derived results have also been computed for bilateral transactions and pool transactions for with/without FACTS devices.

Index Terms – Bilateral model, Cost function, FACTS cost model, Hybrid model, Pool model and Real and Reactive power,

I. INTRODUCTION

The electricity supply industries all over the world is alight upon restructuring their electricity business into competitive environment for better utilization of the resources, technological innovation, quality of service and adequate better choice to the consumers at competitive prices. Electricity sector deregulation, also known as restructuring is expected to attract investment, promote efficiency, increase technical growth and improve better operation of the system [1].

Reactive power service is one of the key issues of ancillary services and it paves the way for better transaction of power in electricity markets. The reactive power service is essentially required for transmission of active power, voltage control and reliable operation of the systems in the competitive electricity market structure. The prolonged research on transmission pricing shows that, there is no generalized theory on pricing methodology. In general, each electricity market has adopted a method based on particular topology of the network [2].

Many investigations and several studies have been carried out of proper method of reactive power pricing. In order to maintain the good voltage profile and preserve system operational reliability, the spot price of reactive power has gained importance and should be given much attention [3].

Most of the researchers have been focused on real power transactions as the important one. In some systems, the reactive power cost is included in the price of active power pricing of real and reactive power [4]. In ref [5], the authors analyzed the reactive charging scheme composed of recovering capital cost and operating cost. Locational spot prices for reactive power could provide adequate incentives for loads to consume reactive power and for generator to produce reactive power sufficiently.

More advanced technology is provided for secure and reliable operation of transmission and distribution in power system. To increase the power transfer capability and achieve better utilization of existing power system, the flexible AC transmission system (FACTS) controller have become imperative. FACTS controllers have the capability of direct-line control of transmission line flows by changing the transmission line parameters such

as line impedance and power angle of transmission corridors [6].

In ref [7], the authors proposed that installation of FACTS controllers with their optimal location can change the power flow pattern stability, security, reliability and economic efficiency of the system by changing the wheeling cost of power due to impact on nodal price of real and reactive price and therefore these FACTS devices cost functions should also be incorporated in an objective function which provide noticeable changes in nodal prices of both real and reactive power.

Olivera et al., suggested that allocation of FACTS devices and their domination in transmission pricing was presented in ref [8]. The impacts of SVC and TCSC on the spot prices of real and reactive power were determined and maximizing the social welfare function are studied in [9].

The effects of optimally located SVC and TCPAR on the real and reactive power price includes the costs of FACTS controller has been described in ref [10]. In the restructured environment the number of bilateral transactions has grown rapidly and it is essential to help the system operator to evaluate their impacts on system operation and impacts on nodal price determination [11]. Singh and David et al., introduced the concept of optimal location of FACTS device which is determined using line power based sensitivity index, performance based index, loss sensitivity based index, price based index with inclusion of FACTS parameters [12]. In ref [13], the authors ascertain the locational marginal prices with SVC controller for pool and hybrid market model.

In this article, nodal prices have been computed for pool and bilateral transactions by considering of three different reactive power cost model for generator's reactive power cost calculation. The Simulation result has been done in two parts. The first part includes the numerical approach without considering FACTS devices and the second part includes the FACTS devices in the system. The impacts of FACTS controller have been incorporated taking their cost functions into account. The proposed approaches have been tested on Indian 246-bus NREG system and the comparisons have been given for different reactive power cost model of pool and bilateral model to illustrate the superior performance of the system.

II. VARIOUS MODELS IN ELECTRICITY MARKET

In the deregulated electricity market structure, the different transactions may takes place either directly or indirectly between sellers and buyers because the market is under competition and hence it becomes an open access. Based on the transactions, the electricity market model is modeled based on their mode of transaction. There are three major model of transaction of power in electricity market structure [14,15].

1. Pool Co Model
2. Bilateral Model
3. Hybrid Model

Pool Co Model

The pool co model is defined as the centralized market place which clears the market for sellers and buyers .The power sellers and buyers submit their bids to inject power in to and out of the pool. In this model, only single entity called system operators plays a major role to have the contract between the retailer and consumers. The low cost generator would especially reward in this model.

Bilateral Contract Model

This model is referred as the direct access model because this model permits the direct contracts between the power producers and the consumers without entering in to pooling arrangement. The establishment of non-discriminatory access and the pricing rules for the transmission and distribution systems the direct sales of power takes place between the utilities are guaranteed.

The bilateral contract model may also include some other transaction such as:

Bilateral Transactions

A bilateral transactions means there is a direct transaction between the power producers and the customers.

Multilateral Transactions

Multilateral transactions are the extension of bilateral transactions and the trading arrangement is done by energy brokers with two or more parties.

Ancillary Service Transactions

Ancillary services are defined as all those activities such as regulation of frequency and tie-line power flows, voltage and reactive power control and ensuring system reliability and maintain secure operation of the system. To provide the essential ancillary services for system regulation, the system operator (SO) may arrange some direct transactions with some of the generation companies (GENCOs). The ISO has the major role in this transaction and simply dispatches all transactions and charges for the service.

Hybrid Model

It is a combination of both pool co model and bilateral model. In this model, trading takes place between the group of sellers and buyers and the consumers and producers has the choice of selection in any model.

A. Mathematical Approach of Bilateral Contract Model

The bilateral contract model used in this work is basically a subset of the full transaction matrix T proposed in [16]. Its general concept is mostly composed as a multimode case, where the seller from the Generation Companies (GENCO_s) and buyer from distribution companies (DISCO_s) are involved in the process. The transaction matrix T is a collection of all possible transactions between Generation (G), Demand (D) and any other trading entities (E) such as marketers and brokers and it is shown in equation (1).

$$T = \begin{bmatrix} GG & GD & GE \\ DG & DD & DE \\ EG & ED & EE \end{bmatrix} \quad (1)$$

It is assumed that entire transactions activities are employed between GENCO_s (G) and DISCO_s (D). There is no contract made between the two suppliers or two consumers. Hence it is noted that, the diagonal block matrices (GG and DD) are considered as zero. Hence neglecting transmission losses, the transaction matrix can be simplified as:

$$T \equiv [GD] = [DG^T] \quad (2)$$

Where GD and DG represents the bilateral transaction between GENCOs and DISCOs.

From that, each element of transaction matrix T namely t_{ij} represents bilateral contracts between suppliers (p_{gi}) of row i with a consumer (p_{dj}) of column j. Then the sum of row i represents the total power produced by generator i and sum of column j represents the total power consumed at load j.

$$T \equiv \begin{bmatrix} t_{1,1} \dots & t_{1,nd} \\ t_{2,1} \dots & t_{2,nd} \\ t_{ng,1} \dots & t_{ng,nd} \end{bmatrix} \quad (3)$$

Where n_g and n_d represents generators and loads respectively.

Based on the conventional load flow variables, the generation p_g and load p_d vectors can be expanded in two dimensional transaction matrix T as given in equation (4).

$$\begin{bmatrix} P_d \\ P_g \end{bmatrix} = \begin{bmatrix} T^T & 0 \\ 0 & T \end{bmatrix} \begin{bmatrix} u_g \\ u_d \end{bmatrix} \quad (4)$$

In the above matrix equations, the u_g and u_d are column vectors of ones with the dimension of n_g and n_d respectively. There are some intrinsic properties which are associated with the matrix (T) and these properties have been explained in [17]. Each contract has the range originates from zero to maximum allowable value T_{ij}^{max} . This maximum value is bounded by the value P_{gi}^{max} or P_{dj}^{max} whichever is smaller. Hence the range rule satisfies the following equation.

$$0 \leq T_{ij} \leq T_{ij}^{max} \leq \min(P_{gi}^{max}, P_{dj}^{max}) \quad (5)$$

There is a possibility for some contracts to be firm, so that T_{ij}^0 is equal to T_{ij}^{max} . According to flow rule, the line flows of the network in ac model can be formulated as follows:

$$P_{line} = ACDF [P_g - P_d] \quad (6)$$

The AC distribution factors (ACDFs) is defined as the change in real power flow (Δp_{ij}) in a transmission line-k

connected between bus-i and bus-j due to unit change in power injection (Δp_n) at any bus-n.

Mathematically, the matrix ACDF, for line-ij can be written as

$$ACDF_n^{ij} = \Delta p_{ij} / \Delta p_n \quad (7)$$

The matrix ACDF is the distribution factors matrix which is computed using AC load flow technique [18]. The representations of p_{gb} and p_{db} are substituted by using the definition of T as given in equation (4) and the line flows obtained for bilateral transaction can be expressed in other way as:

$$P_{line} = ACDF \begin{bmatrix} T - T^T \\ 1 \end{bmatrix} \quad (8)$$

The matrix ACDF is based on Jacobin sensitivity matrix and it includes any changes in the system operating conditions.

$$GD_{sb}^{max} = \min(P_{GB, sb}^{max}, P_{DB, bb}) \quad (9)$$

III. Mathematical Formulation for Nodal Price Determination with Reactive Power Cost Model of Generators

In this paper, the optimization problem is solved by minimizing total cost subject to equality and inequality constraints for pool electricity market model by including real and reactive power nodal prices, fuel cost, cost components of reactive power with different cost model and Facts devices.

Objective function:

The objective function can be represented as:

$$\text{Min TC} = \sum_{i=1}^n \text{Cost}(P_i) + \text{Cost}(Q_i) + \xi_{UPFCi} * \text{Cost}(F_i) \quad (10)$$

The objective function consist of three cost components such as cost of real power, cost of reactive power and cost of FACTS devices.

Let

Cost (P_i) = Cost function of real power for NG (No of generators)

Cost (Q_i) = Cost function of reactive power for set of NG generators

Cost (F_i) = Cost function of FACTS devices (UPFC).

where:

$$\text{Cost}(P_{Gi}) = a_p P_{Gi}^2 + b_p P_{Gi} + c_p \quad \$/h \quad (11)$$

$$\text{Cost}(Q_{Gi}) = a_q Q_{Gi}^2 + b_q Q_{Gi} + c_q \quad \$/h$$

The operating constraints are considered from the ref [19].

In case of hybrid market model, additional constraints to be satisfied are:

Equality constraints for bilateral transactions using transaction matrix GD are expressed as follows:

$$P_{DB} = \sum_{i \in sb} GD_{ij} \quad (12)$$

$$P_{GB} = \sum_{j \in bb} GD_{ij} \quad (13)$$

$$P_g = P_{GB} + P_{GP} \quad (14)$$

$$P_d = P_{DB} + P_{DP} \quad (15)$$

$$P_{fb} = ACDF (P_{GB} - P_{DB}) \quad (16)$$

$$P_{fp} = ACDF (P_{GB} - P_{DP}) \quad (17)$$

$$P_f = P_{fb} + P_{fp} \quad (18)$$

$$GD_{sb}^{max} = \min(P_{GB, sb}^{max}, P_{DB, bb}) \quad (19)$$

Limit on FACTS controllers:

$$a'' = a_p \sin 2\theta$$

UPFC:

$$b'' = b_p \sin \theta$$

$$-u \cdot \phi_T^{\max} \leq \phi_T \leq u \cdot \phi_T^{\max} \quad (20)$$

$$c'' = c_p$$

$$-u \cdot I_q^{\max} \leq I_q \leq u \cdot I_q^{\max} \quad (21)$$

$$0 \leq V_T \leq u \cdot V_T^{\max} \quad (23)$$

u is the vector of binary variable ('0's and '1' s) representing the presence or absence of UPFC. It is assumed that '1's represent presence and '0's represent absence of FACTS devices.

IV. Various approaches of Reactive Power Cost

Generally the cost of reactive power produced by a generator is essentially composed of two components namely: fixed cost also called as investment cost and variable cost. The variable cost in turn consists of opportunity cost which includes fuel cost and maintenance cost. The opportunity cost is imposed on the generator resulting from reduction of its active power [20]. The three methods have been considered for calculating the cost of reactive power of generators.

A. Triangular Approach (Method 1)

To overcome the draw backs associated with conventional cost methods, the researchers in 2005, proposed a method for evaluation of reactive power based on a triangular relationship between active and reactive power. In this method, the reactive power cost calculation is essentially composed on the formulation of active power cost, in which the active power is replaced by reactive power using the triangular relationship [21]. In this triangular approach, the cost of reactive power is formulated as follows:

$$Cost(Q) = a'' Q^2 + b'' Q + c'' (\$/hr) \quad (24)$$

From the power triangle the constants a'' , b'' , c'' are calculated depending on power factor ($\cos \theta$) and are calculated as follows:

B. Maximum Real Power Based Approach (Method 2)

In this approach, if the generator produces its maximum active power (P_{\max}), then its cost for generating the active power is (P_{\max}). Hence in this situation, no reactive power is produced and herefore, S equals P_{\max} . The production of reactive power itself does not seem to impose any fuel cost on generator except the losses. Hence, reactive power production by a generator will result in reduce its capability to produce its active power. To generate reactive power Q_i by considering generator i which has been operating its nominal power (P_{\max}), it is required to reduce its active power to P_i such that

$$P_i = \sqrt{P_{\max}^2 - Q_i^2}, \Delta P = P_{\max} - P_i \quad (25)$$

Where ΔP represent the amount of active power that will be reduced as the result of generating reactive power. The cost of reactive power Q_i is precisely calculated by imposing the following cost components.

To accurately calculate the cost of reactive power Q_i , the following cost imposed on generator is given below:

Cost (P_{\max}): Cost of producing active power (P_{\max}) in an hour.

Cost ($P_{\max} - \Delta P$): Cost of generator when producing both active and reactive power with the amounts P_i and Q_i , respectively.

Cost(P_{\max})–Cost ($P_{\max} - \Delta P$): It is represent as the reduction in the cost of active power due to compulsory reduction in active power generation (ΔP) which is useful to generating reactive power with the amount of Q_i . This represents the cost of reactive power production while the operating point of generator is moved from point 1 to point 2 (**Figure 1**) as below:

$$Cost(Q_i) = \frac{P_{\max} - \Delta P}{P_{\max}} Cost(P_{\max}) - Cost(P_{\max} - P_i) \quad \$/hr \quad (26)$$

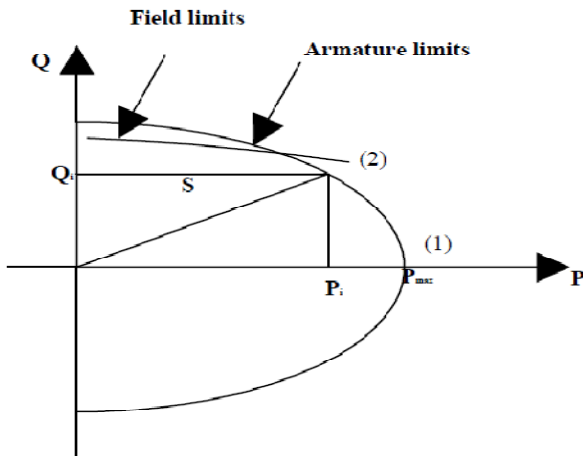


Fig.1. Capability curve of generator.

C. Maximum Apparent Power Based Approach (Method 3)

The reactive power generation capability of a synchronous generator depends upon its power output and usually limited to a value within the MVA rating by the capability of its prime mover. Synchronous generators have the capability to produce the maximum MVA output at a specified voltage and power factor (ranging from 0.85 or 0.9 lagging) continuously without overheating. The output of active power is limited by the prime mover capability to a value should be in MVA rating. Based on the three considerations such as armature current limit, field current limit and end region heating limit, the continuous reactive power capability is limited. From the figure (2), the reactive power output may be able to reduce active power output capacity of generator, which can also serve as spinning reserve. Therefore it makes implicit financial loss to generators. The reactive power production cost of generator is called opportunity cost which depends upon the real-time balance between load and supply in the market, so it is difficult to determine the real value.

The Reactive power cost can be expressed as follows:

$$Cost(Q_{Gi}) = Cost(S_{G_{max}}) - \sqrt{Cost(S_{G_{max}}^2 - Q_{Gi}^2)} * k (\$/h) \quad (27)$$

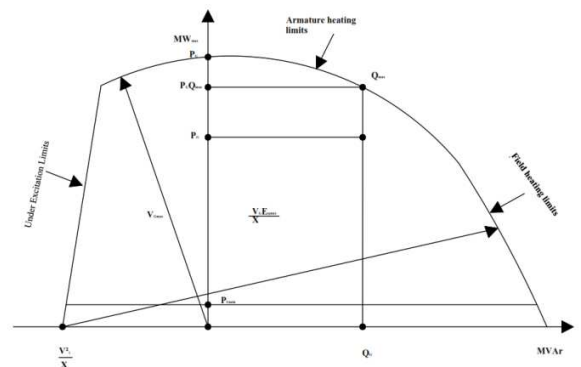


Fig. 2. Loading capability curve of generator.

V. STRUCTURE AND OPERATION OF UPFC

Among the available FACTS devices, UPFC is the most advanced FACTS controller that can be used to enhance steady state stability, dynamic stability and transient stability. The UPFC is capable to act over three basic electric system parameters like line voltage, line impedance, and phase angle. UPFC is a combination of shunt connected device (STATCOM) and a series connected (SSSC) in the transmission line via its dc link. The UPFC is more flexible, fastest and best featured FACTS device and can be used efficiently and flexibly to optimize line utilization and increase system reliability and to dampen system oscillations. The UPFC possesses the property of both absorbing and supplying active and reactive power. The schematic diagram of UPFC is shown in Figure 3.

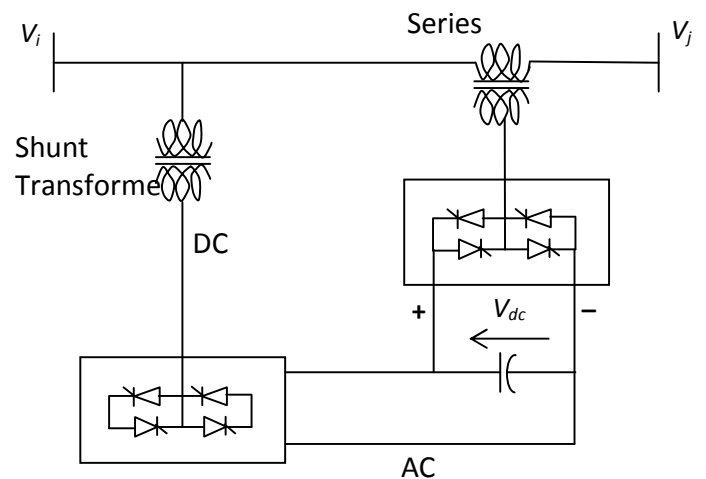


Fig.3. Schematic Diagram of UPFC Controller

It consists of two voltage source converter VSC1 and VSC2 operated from a common dc link provided by a dc storage capacitor which provides dc voltage for the

converter operation. One of the two converters is connected in series with the transmission line through a series transformer and the other in parallel with the line through shunt transformer. Hence the real power can able to freely flow in either direction between ac terminals of two VSCs [22]. The rating of UPFC can be set by the power transfer between the series and shunt converters and the rating should be at least as large as the real power exchanged between the two converters. The main function of UPFC is performed by the series converter, which produces the ac voltage of controllable magnitude and phase angle and also injects the voltage

at this fundamental frequency in series with the transmission line through a booster transformer. The series converter can be used to increase the transmission capability and exchange the real and reactive power through the series connected transformer.

The basic function of shunt converter is to supply or absorb the reactive power demanded by the series converter at the dc terminals and provide independent shunt reactive compensation for the line and also it can be used for local voltage control which improves the system voltage stability.

COST MODEL OF UPFC

The cost function of UPFC can be considered as [23]:

$$\text{Cost (F)} = 0.0003S - 0.26912S + 188.22 \text{ \$ / KVAR} \quad (28)$$

Here S is the operating range of the FACTS devices in MVAR. The unit for generation is expressed in US\$/h and for the investment cost of FACTS devices are in US\$ must be unified in to US\$/hour. Generally the Facts devices will be in service for many years. However,

only a part of its life time is considered to regulate the power flow. In this work, five years have been taken in to account to evaluate the cost function of UPFC device. Therefore, the average value of the investment cost is calculated by the following equation:

$$C_1(f) = \frac{C(f)}{8760 * 5} \text{ \$ / hr} \quad (29)$$

Where C(f) represents the total investment cost of FACTS devices.

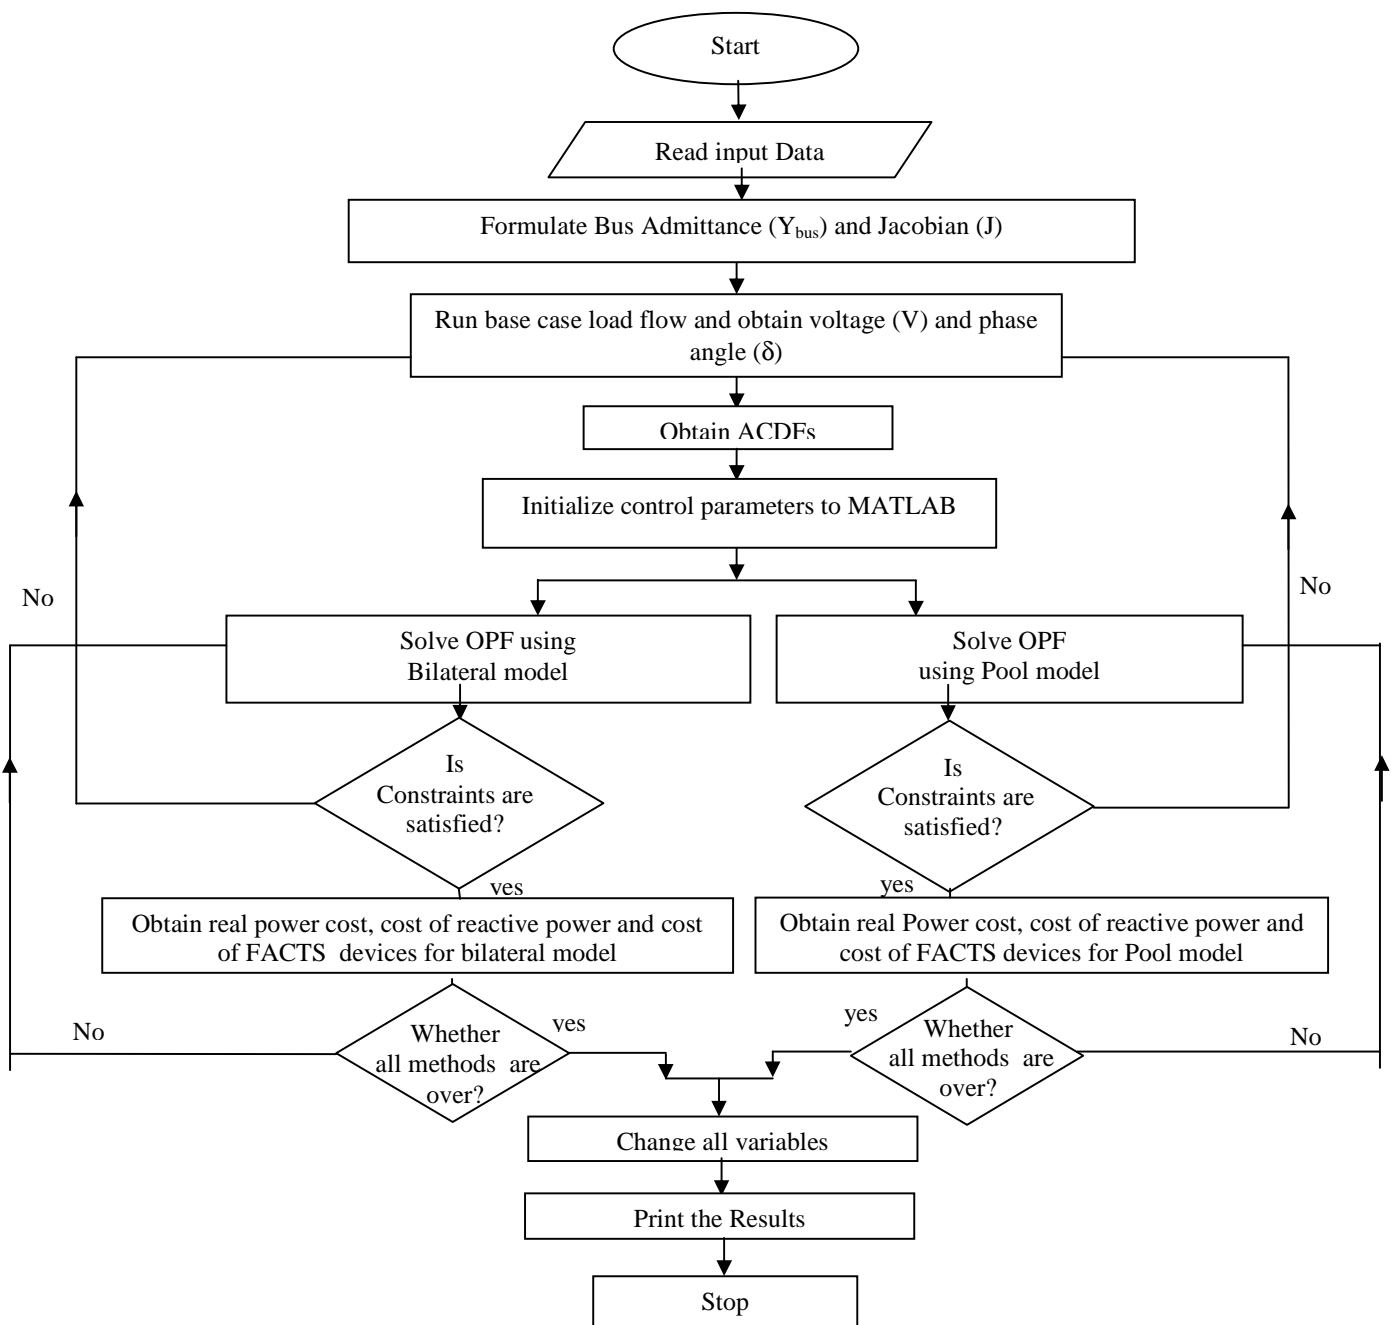


Fig. 4 Flow chart

VI.SIMULATION RESULTS AND DISCUSSION

The proposed methodology has been applied on a Indian 246-bus NREG system. This test system is adopted from reference [24], comprising 42 generating units, 246 buses and 376 transmission lines. The system line data, bus data, reactor data and the single line diagram of Indian 246-bus NREG system are considered from the same reference.

The simulations results are carried out for pool and bilateral model with different cases and the results are characterized as follows:

Case 1:Results without FACTS (UPFC) devices for all methods

Case 2:Results with FACTS (UPFC) devices for all methods

Bilateral transactions for Indian 246-bus NREG system have been expressed in per unit values and are given in Table 1.The transactions values are considered as additional transactions over and above the already committed pool transactions taken in a system.

Table I.Values of Bilateral transactions in per unit for Indian 246-bus NREG system

values of transactions between generator and load bus in per unit	
GD(1,240)=1.5	GD(1,245)=1.0
GD(1,120)=0.2	GD(1,130)=0.3
GD(24,190)=1.2	GD(24,200)=1.0

Case 1: Results for Indian 246-bus NREG System without FACTS Devices

In the first case, the system has not considered the FACTS devices of UPFC. An optimal power flow based non-linear programming has been carried out to

calculate the marginal prices of pool and bilateral market model.

Table 2 describes the marginal prices of pool and bilateral model for all the three methods. Based on the marginal cost comparisons of the methods, it is proved that the marginal prices of real power at buses are found lesser for bilateral model compared to pool model. It is evident that the changes in the pattern of power flow due to the additional bilateral transactions that take place in the system causes the slight variations in the hybrid market model.

Case 2: Results for Indian 246-bus NREG system with FACTS devices

The sudden response of UPFC devices leads to high ability of power system stability and flexibility in managing the power flows. Hence in this case the performance of the proposed method has been improved by installing the UPFC devices. An UPFC has been introduced in the bus number 186 which has a low voltage profile. It is found that the method 1 shows lower real power cost and higher reactive power cost besides the cost function of UPFC is almost same in method 1 and method 2.

It is understood from the Table 3, the marginal cost at bus 1 is maximum in pool model and its value is slightly higher than bilateral model .It is proved that the impact of UPFC can be observed at some of the buses and its impact reduces the marginal prices of the three proposed methods and it is found similar at all the buses. Hence in hybrid market model, the additional bilateral transactions takes place in the system changes the line flows patterns which reduce the marginal prices become superior to pool model. In order to illustrate the performance of the UPFC, the marginal cost of the three proposed methods have been compared with/without FACTS devices and demonstrated in figure (4).

Table II. Results of Locational Marginal prices at few buses of Pool and Bilateral Model for NREG – 246 bus system without FACTS

Bus No.	Method-1		Method-2		Method-3	
	Pool	Bilateral	Pool	Bilateral	Pool	Bilateral
1	144.8021	112.8402	144.8021	112.8402	144.8021	112.8402
2	72.371	62.3676	72.371	62.3676	72.371	62.3676
3	88.8005	74.7624	88.8005	74.7624	88.8005	74.7624
4	88.5822	74.6602	88.5822	74.6602	88.5822	74.6602
5	86.7273	72.9655	86.7273	72.9655	86.7273	72.9655
6	86.7273	72.9655	86.7273	72.9655	86.7273	72.9655
7	87.2786	78.9831	87.2786	78.9831	87.2786	78.9831
8	85.8943	72.1554	85.8943	72.1554	85.8943	72.1554
9	86.7826	73.0206	86.7826	73.0206	86.7826	73.0206
10	86.2181	72.4188	86.2181	72.4188	86.2181	72.4188
11	87.6176	73.7195	87.6176	73.7195	87.6176	73.7195
12	88.1304	74.1767	88.1304	74.1767	88.1304	74.1767
13	86.2184	73.0531	86.2184	73.0531	86.2184	73.0531
14	87.3827	73.4698	87.3827	73.4698	87.3827	73.4698
15	87.4693	73.5305	87.4693	73.5305	87.4693	73.5305
16	88.2086	74.0009	88.2086	74.0009	88.2086	74.0009
17	87.6657	73.4426	87.6657	73.4426	87.6657	73.4426
18	90.1125	75.1364	90.1125	75.1364	90.1125	75.1364
19	82.8538	70.9566	82.8538	70.9566	82.8538	70.9566
20	82.5389	71.3324	82.5389	71.3324	82.5389	71.3324
21	83.2873	68.7928	83.2873	68.7928	83.2873	68.7928
22	80.5355	69.0434	80.5355	69.0434	80.5355	69.0434
23	80.8604	97.737	80.8604	97.737	80.8604	97.737
24	123.037	73.8127	123.037	73.8127	123.037	73.8127
24	87.6669	72.8854	87.6669	72.8854	87.6669	72.8854
25	84.2682	70.2245	84.2682	70.2245	84.2682	70.2245
26	84.4682	72.3892	84.4682	72.3892	84.4682	72.3892
27	90.1123	73.5504	90.1123	73.5504	90.1123	73.5504
28	82.4532	75.0077	82.4532	75.0077	82.4532	75.0077
29	83.7865	74.1671	83.7865	74.1671	83.7865	74.1671

30	82.2867	72.8865	82.2867	72.8865	82.2867	72.8865
31	82.5432	72.1123	82.5432	72.1123	82.5432	72.1123
32	118.976	70.1057	118.976	70.1057	118.976	70.1057
33	91.1008	71.1642	91.1008	71.1642	91.1008	71.1642
34	86.9174	72.1465	86.9174	72.1465	86.9174	72.1465
35	120.348	73.8126	120.348	73.8126	120.348	73.8126
36	84.7653	72.1767	84.7653	72.1767	84.7653	72.1767
37	88.9002	73.0531	88.9002	73.0531	88.9002	73.0531
38	90.0045	73.7371	90.0045	73.7371	90.0045	73.7371
39	83.6754	70.2368	83.6754	70.2368	83.6754	70.2368
40	82.4862	71.4465	82.4862	71.4465	71.4465	71.4465

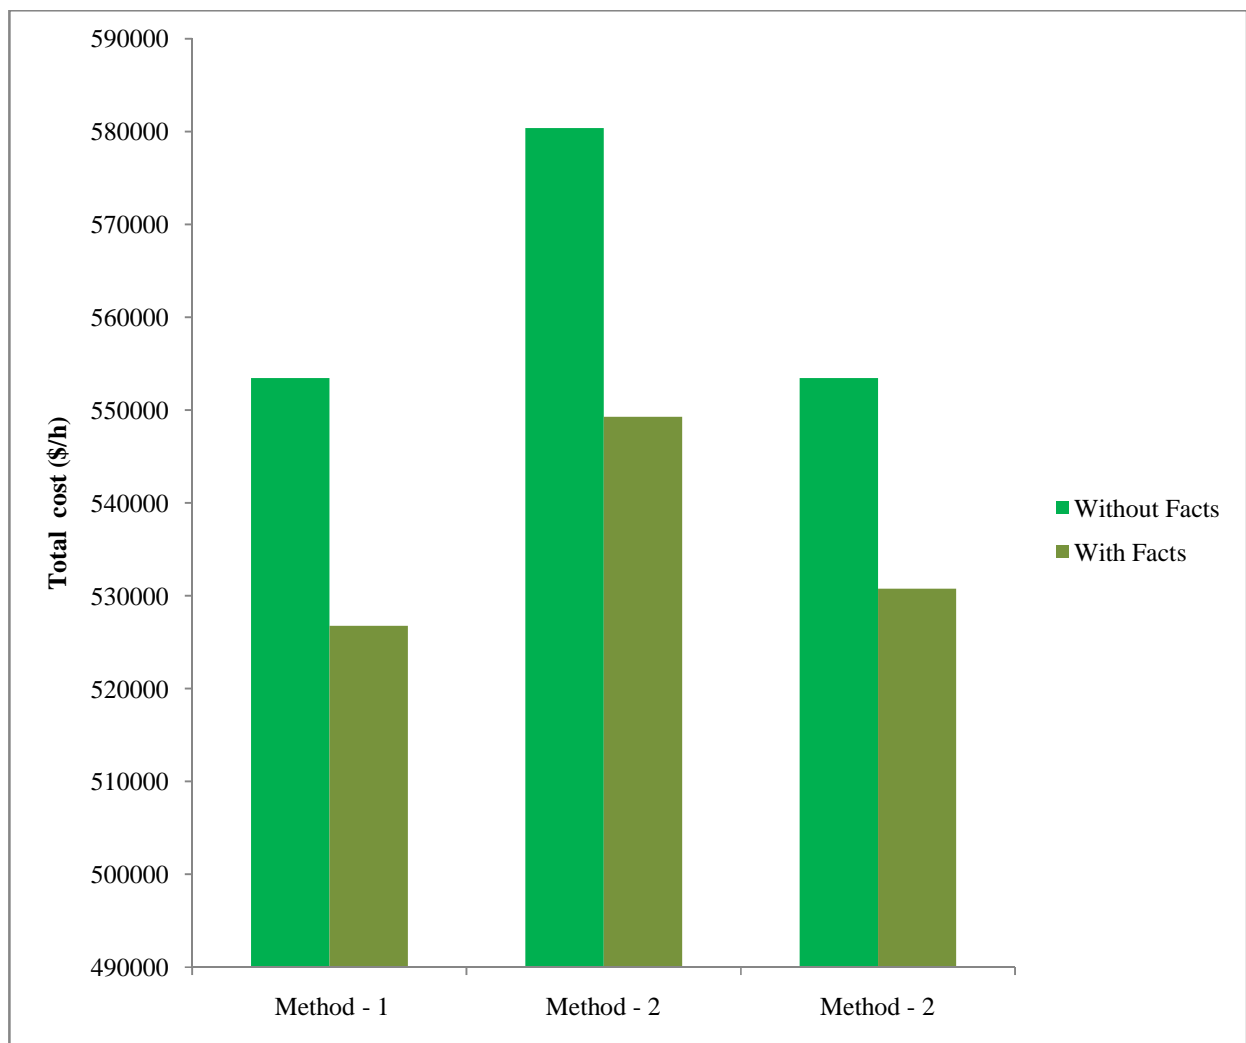


Fig. 5 Comparisons of total Cost for all Methods of with / Without FACTS

Table III. Results of Locational Marginal prices at few buses of Pool and Bilateral Model for NREG – 246 bus system with FACTS

Bus No.	Method-1		Method-2		Method-3	
	Pool	Bilateral	Pool	Bilateral	Pool	Bilateral
1	140.6443	110.6103	140.6443	110.6103	140.6443	110.5463
2	2.1234	61.2034	2.1234	61.2034	2.1234	61.1024
3	8.2345	73.6852	8.2345	73.6852	8.2345	73.4356
4	8.2213	73.1267	8.2213	73.1267	8.2213	73.0976
5	5.8896	72.2255	5.8896	72.2255	5.8896	72.1123
6	5.8896	72.2255	5.8896	72.2255	5.8896	72.1123
7	7.6545	73.0005	7.6545	73.0005	7.6545	73.0002
8	4.9889	71.3323	4.9889	71.3323	4.9889	71.1646
9	84.3678	71.0897	84.3678	71.0897	84.3678	71.0643
10	86.1008	72.3467	86.1008	72.3467	86.1008	72.2361
11	86.1008	71.8968	86.1008	71.8968	86.1008	71.6879
12	87.2112	71.2352	87.2112	71.2352	87.2112	71.1765
13	87.1042	73.1143	87.1042	73.1143	87.1042	73.1043
14	84.7939	74.0123	84.7939	74.0123	84.7939	74.0067
15	87.9988	72.2214	87.9988	72.2214	87.9988	72.1123
16	88.0876	72.3675	88.0876	72.3675	88.0876	72.2654
17	85.3342	73.1268	85.3342	73.1268	85.3342	73.0234
18	82.6075	73.1054	82.6075	73.1054	82.6075	73.0078
19	82.4167	74.1896	82.4167	74.1896	82.4167	74.0896
20	82.5543	69.9015	82.5543	69.9015	82.5543	69.6065
21	79.4437	70.1045	79.4437	70.1045	79.4437	70.1005
22	79.2004	70.2435	79.2004	70.2435	79.2004	70.1123
23	21.6785	67.8202	21.6785	67.8202	21.6785	67.4327
24	87.9078	68.1289	87.9078	68.1289	87.9078	68.1133
24	82.1776	97.1643	82.1776	97.1643	82.1776	97.0088
25	82.1776	72.6607	82.1776	72.6607	82.1776	72.66
26	83.0097	71.2668	83.0097	71.2668	83.0097	71.2662

27	112.6787	72.4554	112.6787	72.4554	112.6787	72.3356
28	122.134	73.3389	122.134	73.3389	122.134	73.0643
29	78.2345	73.1682	78.2345	73.1682	78.2345	73.0078
30	77.9908	96.5543	77.9908	96.5543	77.9908	96.2343
31	82.4455	93.8926	82.4455	93.8926	82.4455	93.7761
32	83.6677	75.4166	83.6677	75.4166	83.6677	75.4018
33	84.1122	75.4488	84.1122	75.4488	84.1122	74.2214
34	122.889	74.3325	122.889	74.3325	122.889	71.0001
35	87.987	71.0008	87.987	71.0008	87.987	70.3636
36	82.776	70.6576	82.776	70.6576	82.776	68.4292
37	88.445	68.4698	88.445	68.4698	88.445	67.2424
38	86.244	67.4545	86.244	67.4545	86.244	72.3356
39	84.2816	72.4305	84.2816	72.4305	84.2816	72.4305
40	83.1432	71.6789	83.1432	71.6789	83.1432	71.6789

VII. CONCLUSION

In this work, an attempt has been made for determination of marginal price for real and reactive power with the reactive power's cost model function. The inclusion of FACTS devices and its cost model have been incorporated to find their impact on real and reactive power nodal price at each bus is presented. The comparison results of marginal prices of real and reactive power have been obtained for pool model and bilateral model. From the results it is observed that, total cost and cost component of reactive power is found minimum in third method and fuel cost obtained is minimum in third method. By the incorporation of the cost model of FACTS devices plays an crucial role for variation of marginal prices for pool model and bilateral model and the obtained marginal prices results are found lower at all buses compared to pool model due to the change in flow pattern with additional bilateral transactions.. Based on the results, it is concluded that reactive power cost component have considerable effect on nodal price determination of real and reactive power at each bus.

ACKNOWLEDGEMENTS

The authors gratefully acknowledge the authorities of Annamalai University for the facilities offered to carry out this work.

REFERENCES

- [1] M.L. Baughman and S.N.Siddiqi, "Real Time Pricing of Reactive Power: Theory and Case Study Results," *IEEE Transactions on Power Systems*, Volume 6, No.1, pp 23-29, 1991.
- [2] S.Hao and A.Pepalexopolous, "A Reactive Power Pricing and Management," *IEEE Transactions on Power Systems*, Volume 12, No.1, pp 95-104, 1997.
- [3] Ro K, "Calculation of Reactive Power Charges Under Competition of Electric Power Industries", *Electrical Engineering*, 85, pp 169-175, 2003.
- [4] Alvarado F, "Reactive Power as an Identifiable Ancillary Service", *Alberta report*, 2003.
- [5] Y.Z.Li and A.K. David, "Wheeling Rates of Reactive Power Under Marginal Cost Theory," *IEEE Transactions on Power Systems*, Volume 10, No. 3, 1993.
- [6] L.J.Cai and Istvan Erlich, "Optimal Choice and Allocation of FACTS Devices Using Genetic Algorithms," *Proceedings of ISAP, intelligent Systems Application To Power Systems*, Lemons, 31-August-3 September, 2003.
- [7] J.B.Gill, T.G.S.Roman, J.J.A.Rioa and P.S.Martin, "Reactive Power Pricing: A Conceptual Framework for Renumeration and Charging Procedures," *IEEE Transactions on Power Systems*, Volume 15, No.2, pp 483-489, 2000.
- [8] E.J.De Olivera, J.W.M.Lima and J.L.R.Pereira, "Flexible Ac Transmission

- Devices Allocation and Transmission Pricing,"*Electric Power and Energy Systems*, Volume 21, No.2, pp 111-118,1999.
- [9] S.C.Srivastava andr.K.Verma,"Impact of Facts Devices on Transmission Pricing in A Deregulated Market," *International Conference on Electric Utilitu DereguAtion and Restructuring and Power Technologies*, Drpt, London, pp 642-648, April 4-7, 2000.
- [10] G.B.Shrestha and W.Feng,"Effecrs of Series Compensation on Spot Price Market,"*Electrical Power and Energy Systems*,Volume 27, No.5-6,pp 428-436.2005.
- [11] F.D.Galiana and M.Ilic,"A Mathematical Framework for The Analysis and Management of Power Transactions Under Open Access," *IEEE Transactions on Power Systems*,Volume 13.No.2,pp 681-687,1998.
- [12] Singh, S. N. and David, A. K., "Placement of FACTS Devices in Open Power Market" in *Proc. 5th Conference on Advances in Power System Control, Operation and Management, APSCOM*, pp. 173-177, Hong Kong, 2000.
- [13] A.Kumar and Punit Kumar," Locational Marginal Prices With SVC in indian Electricity Market", *International Journal of Engineering Science and Technology*,Volume 3, No.3,pp 9-24,2011.
- [14] Kankare Bhattacharya, Math H.J.Bollen,Jaap E.Daalder."Operation of Restructured Power System",*Kluwer Academic Publishers*,2001.
- [15] Hamoud G,"Feasibility Assessment of Simultaneous Bilateral Transactions in A Dergulated Environment",*IEEE Transactions on Power Systems*, Volume 15, No.1,pp 22-26,2000.
- [16] Cheng,J.W.M,Galiana F.D and M.E.Gills,D.J.,,"Studies of Bilateral Contracts With Respect To Steady State Security in A Deregulated Environment",*IEEE Transactions on Power Systems*, Volume 15,No.3,pp 1020-1025,1998.
- [17] Chanana S and Kumar A,"Marginal Prices of Real and Reactive Power in Hybrid Electricity Markets",*Journal of CBIP*,January 2010.
- [18] Dai Y,Ni,Y.X.Wen,F.S and Han,Z.X,"Analysis of Reactive Power Under Deregulation", in *Proceedings of IEEE PES*, Volume 1,Issue 1,pp2162-2167,2000.
- [19] Y.Zhao,M.R.Irving and Y.Song, A Cost Allocation and Pricing Method of Reactive Power Services in The New Deregulated Electricity Market Environment," *Proceedings of IEEE Transmission and Distribution Conference*,Dalian,August 2005.
- [20] S.Hasanpour, R,Ghazi and M.H.Javidi,"A New Approach for Cost Allocation and Reactive Power Pricing in a Deregulated Environment",*Electrical Engineering*, 91, pp 27-34.2009.
- [21] A.K.Sharma and S.Chanana,"New Multiobjective Optimization Problem for Secure Bilateral Transaction Determination With Upfc in Hybrid Electricity Markets,"*Electric Power Components and Systems*, Volume 36,No.6, pp555-574, 2008.
- [22] Ashwani Kumar,"Reactive Power and Facts Cost Model's Impact on Nodal Pricing in Hybrid Electricity Markets,,: *Smart Grid and Renewable Energy*, Volume 1, Issue 2, pp 230-244, 2011.
- [23] A.K.Sharma and S.Chanana,"New Multiobjective Optimization Problem for Secure Bilateral Transaction Determination With Upfc in Hybrid Electricity Markets,"*Electric Power Components and Systems*, Volume 36,No.6, pp555-574,2008.
- [24] Indian 246-Bus NREG System-A Report From *Department of Electrical Engg*, IIT, Kanpur.

NOMENCLATURE

N_g	Set of generators
N_b	Number of buses in the system
N_d	Number of load buses
P_{gi}	Active power pool generator- i
C_i	Fuel cost of pool generator- i
a_{gi}, b_{gi}, c_{gi}	Cost coefficients in \$/h, \$/MWh, \$/MWh ²
P_i	Real power injection at bus- i
Q_i	Reactive power injection at bus- i
P_{gi}, Q_{gi}	Real and reactive power generation at bus- i
I_a	Armature current of generator
P_{di}, Q_{di}	Real and reactive power demand at bus- i
V_i	Voltage magnitude at bus- i
δ_i	Voltage angle at bus- i
$P_{gi}^{\min}, P_{gi}^{\max}$	Minimum and maximum real power generation limit
$Q_{gi}^{\min}, Q_{gi}^{\max}$	Minimum and maximum reactive power generation limit
x	State vector of variables V, δ ;
u	Control parameters, $P_{gi}, Q_{gi}, P_{gb}, P_{gp}$;
p	Fixed parameters $P_{di}, P_{db}, P_{dp}, Q_d, T_{ij}$;
$\zeta_{UPFCi}^{\text{int}}$	An integer variable showing absence or presence of FACTS devices with integer values $\{0,1\}$;
GD	Bilateral Transaction Matrix
T	Transaction Matrix
ACDF	Distribution Factors
P_{DB}	Vector of Bilateral Demand
P_{DP}	Vector of Pool Demand
P_{GB}	Vector of Bilateral Generation
P_{GP}	Vector of Pool Generation